


Volume of geothermal water fluids from the Hellisheidi Power Plant by point of release

Until September 2011, the largest part of geothermal water was reinjected through wells in Gráuhnúkar. Geothermal water from the plant increased when the Sleggjan plant was launched in autumn 2011, but the reinjection field at Húsmúli was then put into full operation. Since then the geothermal water from the plant has increased. Reinjection in discontinued production wells within the production field started in 2014 and in boreholes in Threngsli in 2016. There was a significant decrease in the release of geothermal water on the surface via overflow in the latter part of 2011 with improvements in the power station's operations, but they increased again around mid-2014 with the diminishing reception of reinjection fields. The situation improved significantly in 2018.

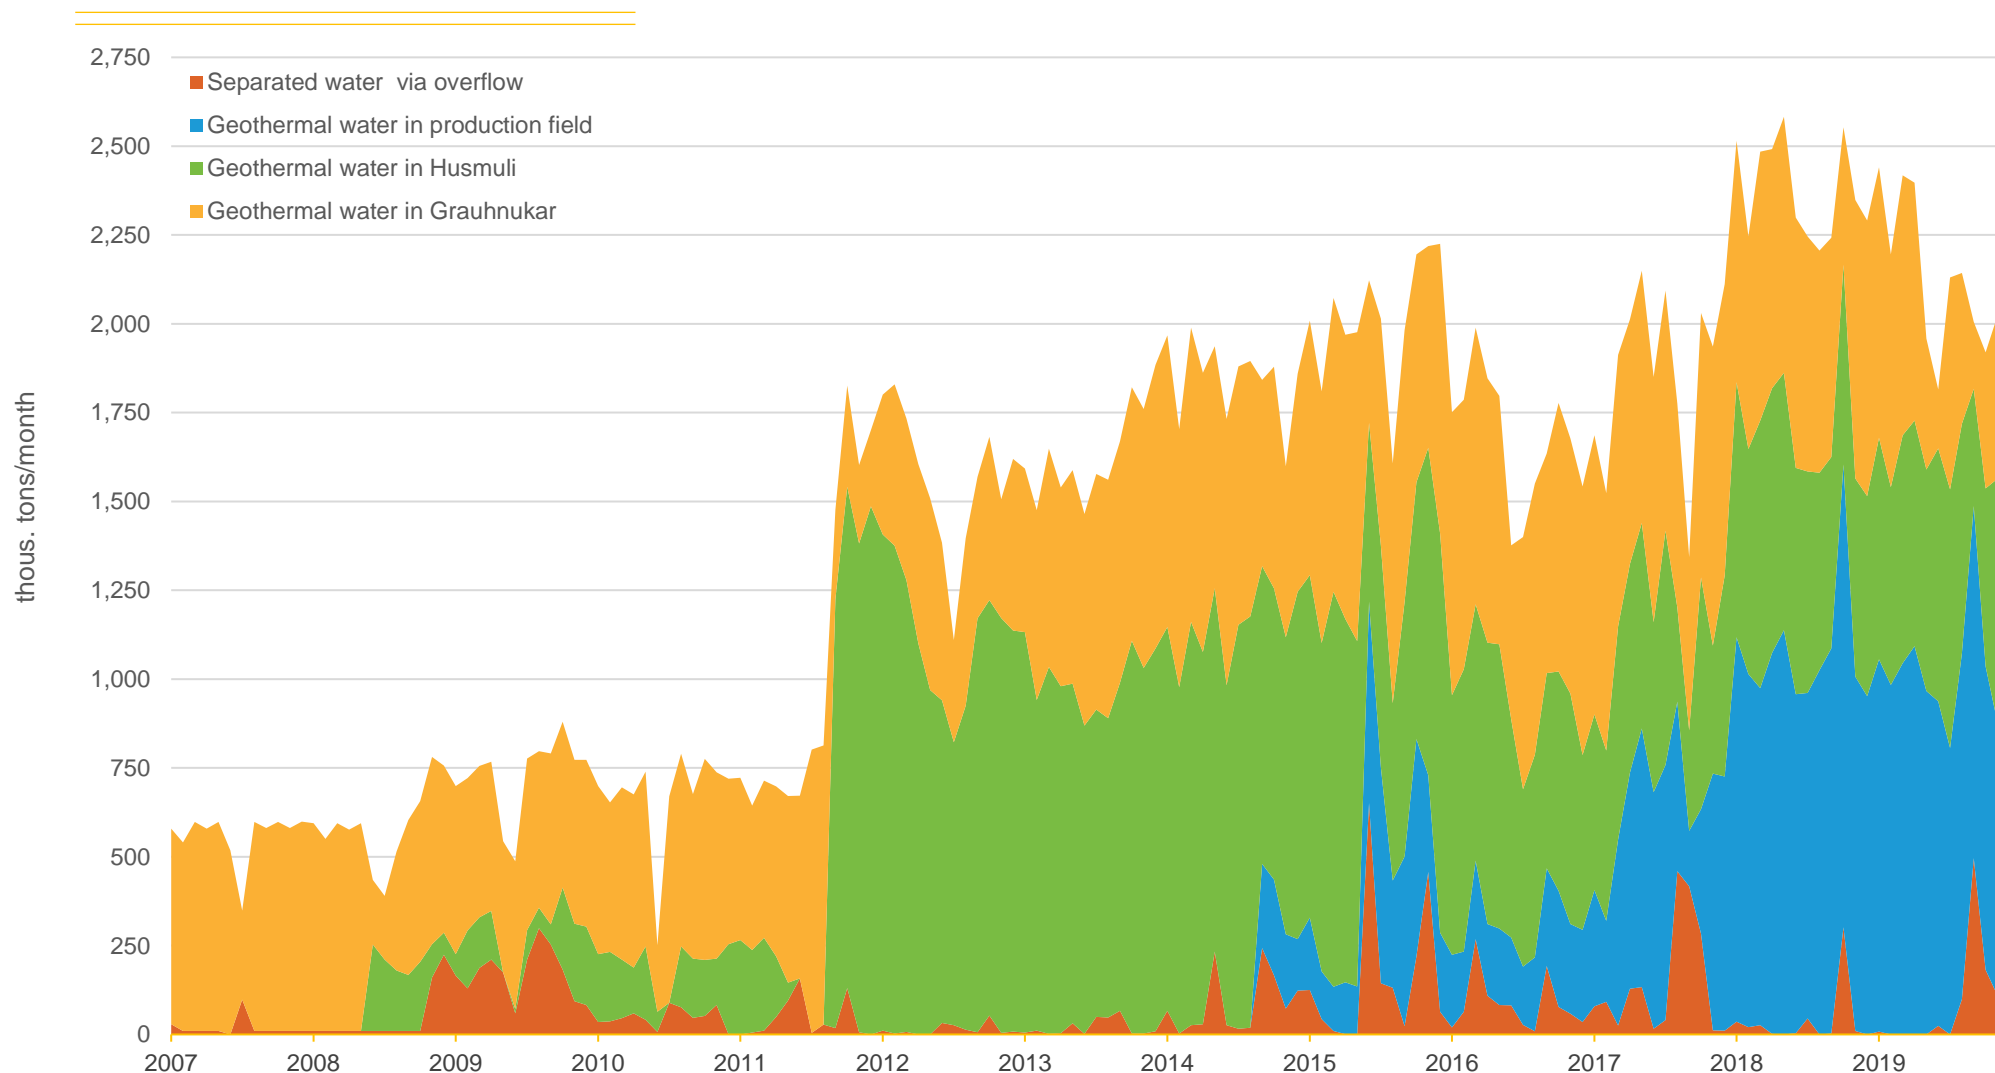

Year	Seperated water via overflow thous. tons/year	Geothermal water in Gráuhnúkar thous. tons/year	Geothermal water in Húsmúli thous. tons/year	Geothermal water in production field thous. tons/year	Total geothermal water thous. tons/year
2007	215	6,502			6,718
2008	483	5,439	1,123		7,045
2009	2,050	5,335	1,382		8,767
2010	572	5,684	1,826		8,082
2011	506	5,374	6,461		12,341
2012	163	5,224	13,358		18,745
2013	233	7,620	11,733		19,586
2014	1,024	8,281	11,982	860	22,147
2015	1,870	8,422	10,107	3,803	24,202
2016	1,025	8,585	7,831	4,213	21,654
2017	1,699	8,506	6,001	10,147	26,353
2018	447	7,982	7,611	12,625	28,665
2019	919	6,409	7,445	11,206	25,980
Total	11,206	89,363	86,860	42,854	230,284

Volumes are rounded to thousands of tons